


Labeling Guidelines for:


FIXED ABOVE GROUND TANKS

Both the NFPA 30 and the IFC use capacity to differentiate tanks from other liquid holding containers. NFPA 30 defines a tank generically as a vessel having a liquid capacity exceeding 60 gallons and intended for fixed installation.


Fixed tanks must be labeled with their contents. If the contents are hazardous materials they must have a NFPA 704 Placard attached to the tank indicating the hazards (see www.shastacollege.edu/hazmat/NFPA704Labels).

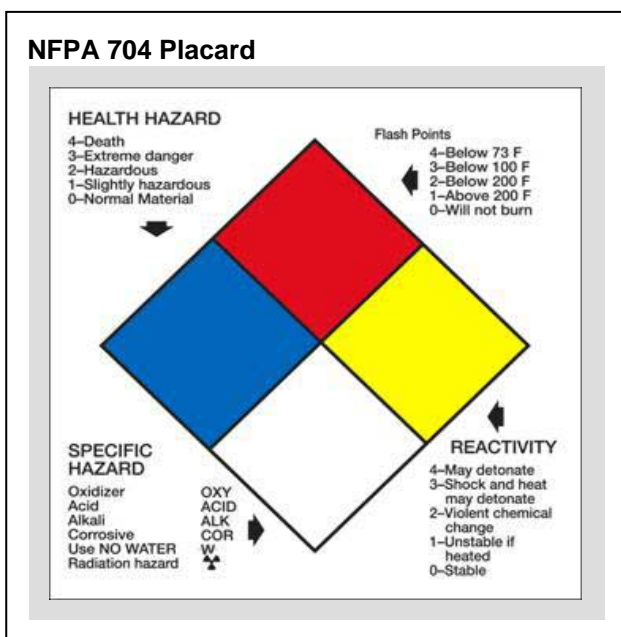

Above-ground Tank Containing Hazardous Material

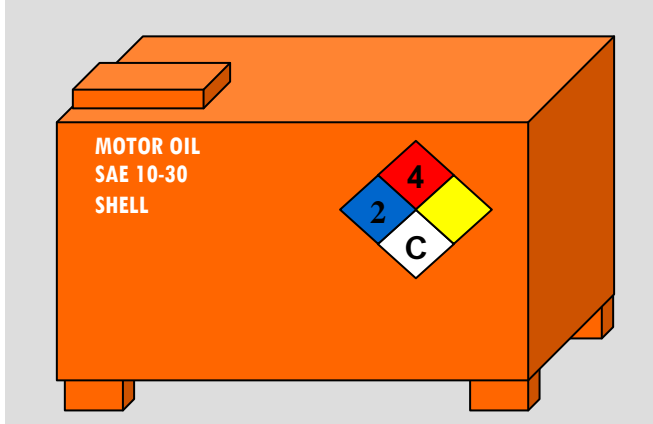

Above-ground Tank Containing Non-Hazardous Material

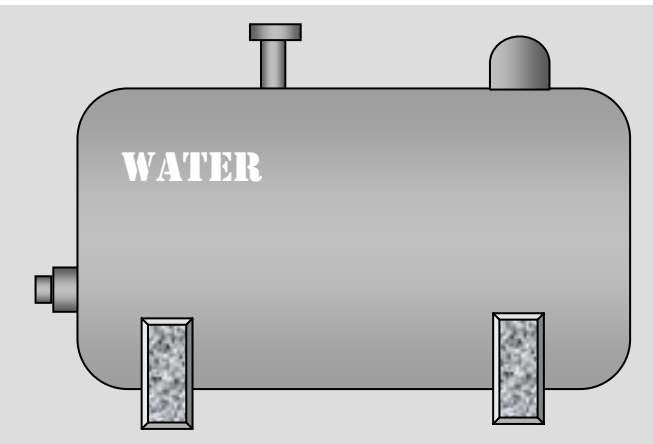

The "Right to Know Act" requires that all tanks are labeled with their contents. If the contents are hazardous, the tank must also have an NFPA 704 label.