


Labeling Guidelines for:


COMPRESSED GAS CYLINDERS

All cylinders will be labeled with the:

- Product.
 - Hazard warning using the proper DOT placard/label.
- (see www.shastacollege.edu/hazmat/DOTLabels).

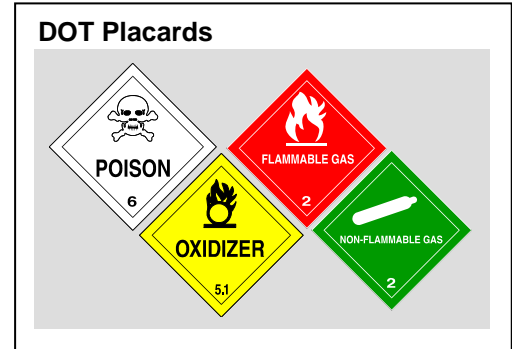

All vertical cylinders will be chained.
Full and empty cylinders will be stored separately.

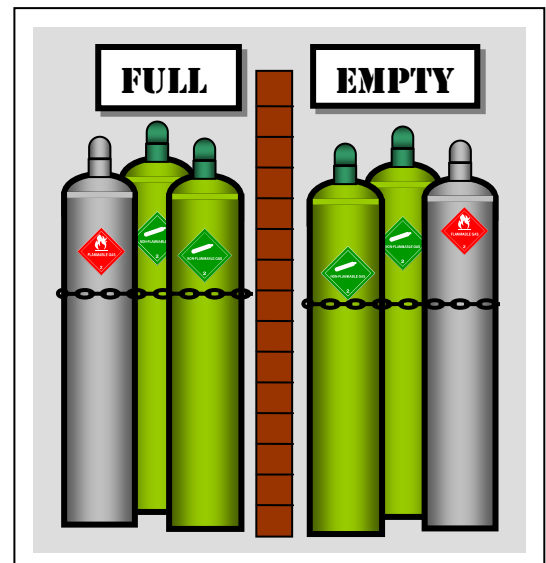

Cylinders containing compressed gas are always dangerous because they are pressurized.

Appropriate NFPA 704 Placards must be in place where cylinders are stored (see www.shastacollege.edu/hazmat/NFPA704Labels).

